


BS

Brazilian Dental Science

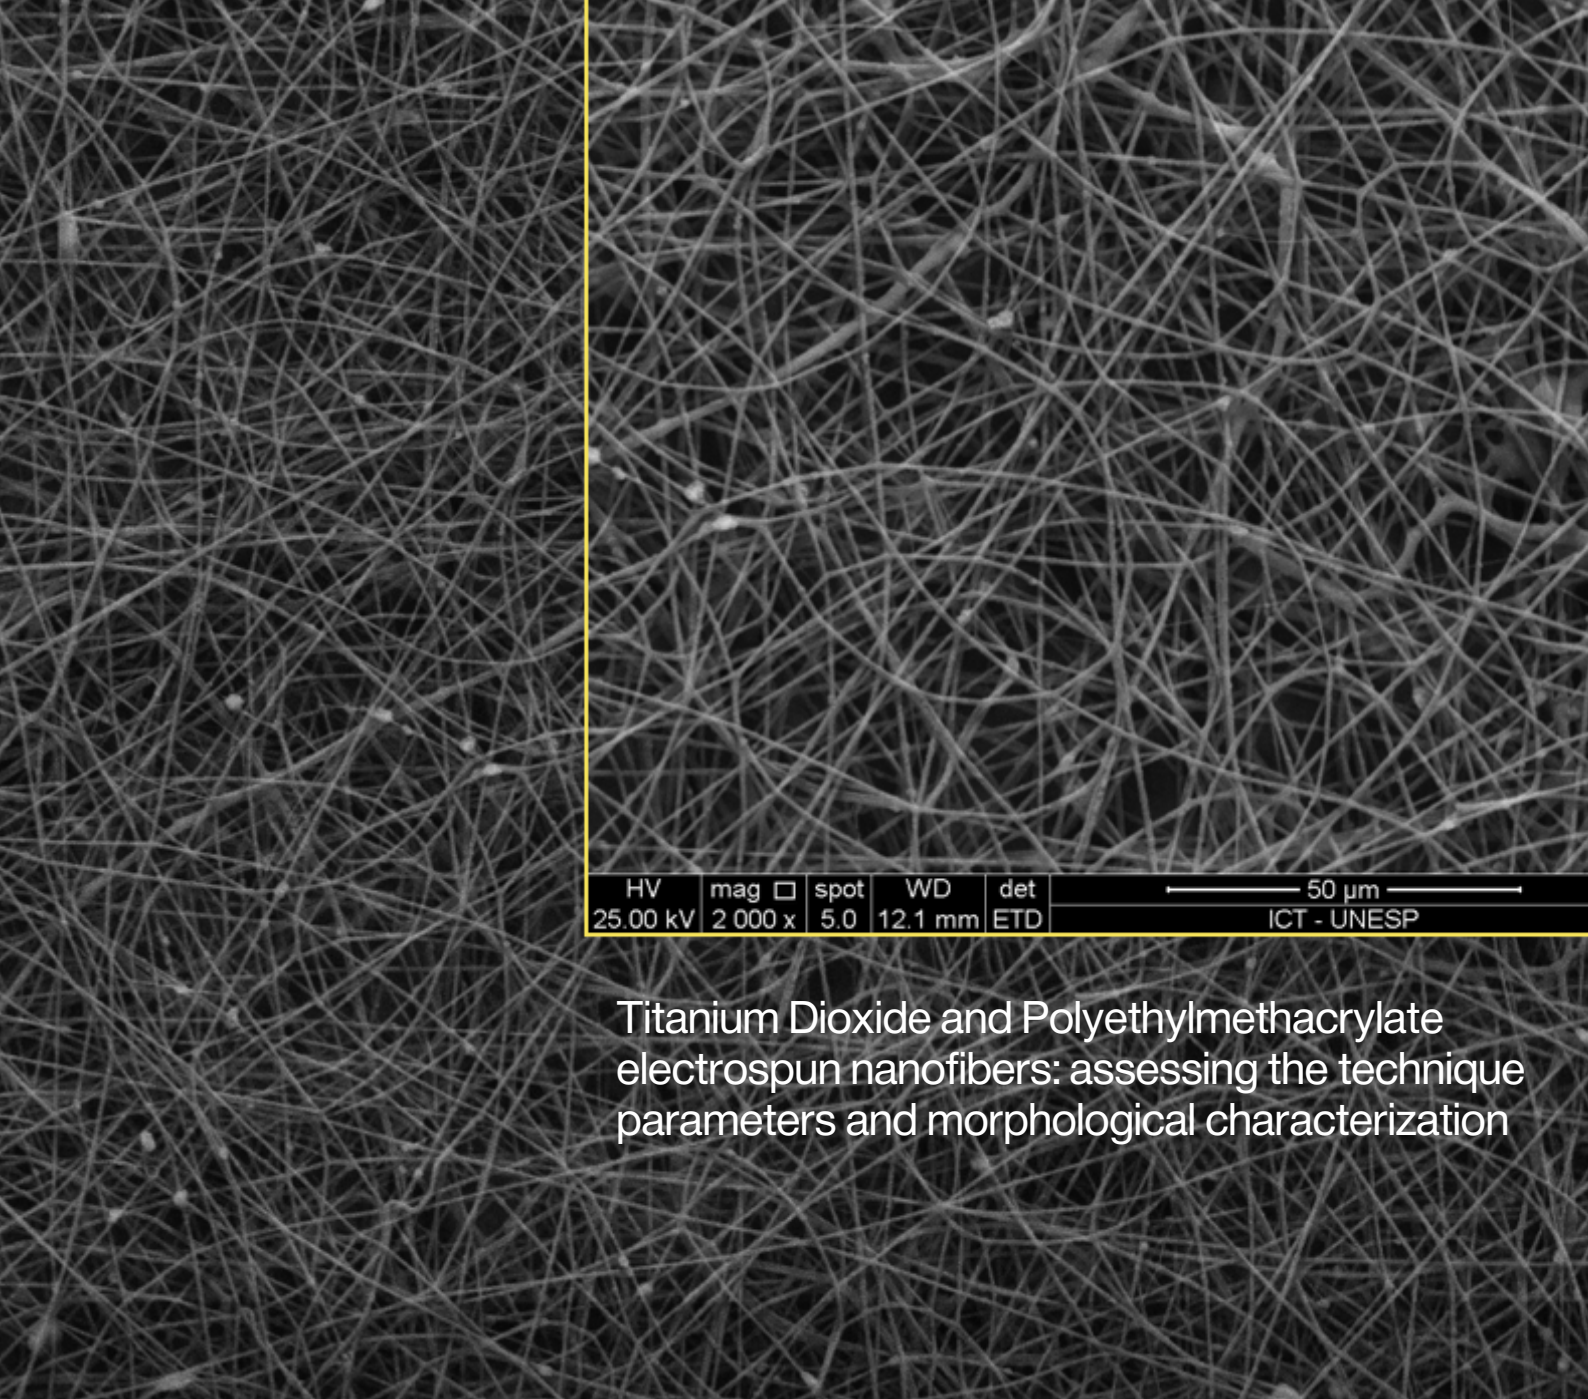

HV mag □ spot WD det
25.00 kV 2 000 x 5.0 12.1 mm ETD

50 µm
ICT - UNESP

Titanium Dioxide and Polyethylmethacrylate electrospun nanofibers: assessing the technique parameters and morphological characterization